


FIG - 1

Configuration de la vittine  Dimensions   Peramètres physiques		×
Distance contro-Capteurs  CH =	cv = 500	Latin
Zone autorisée  Com haut gauche  X = 0 poets  Y = 37 poets  L = 1280 piects  H = 367 piects  Acquéir	IY E	Cran I

**FIG - 2A** 

2/9

" Mrs. WO 02/01490

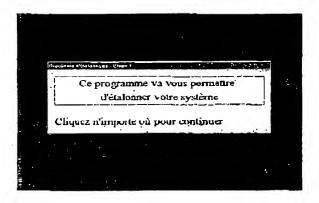

**FIG - 2B** 



FIG-2C

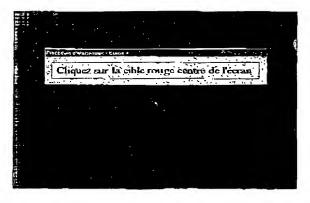


FIG-2E



FIG - 2D

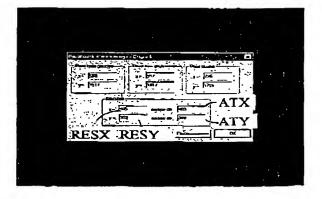


FIG - 2F

3/9



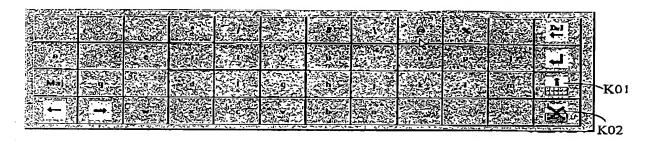



FIG - 3 A



**FIG - 3 B** 

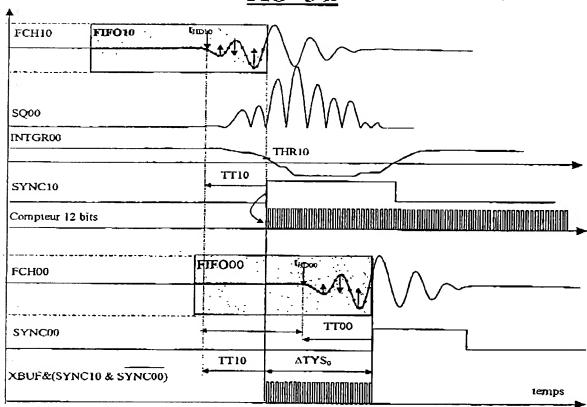



**FIG-4** 

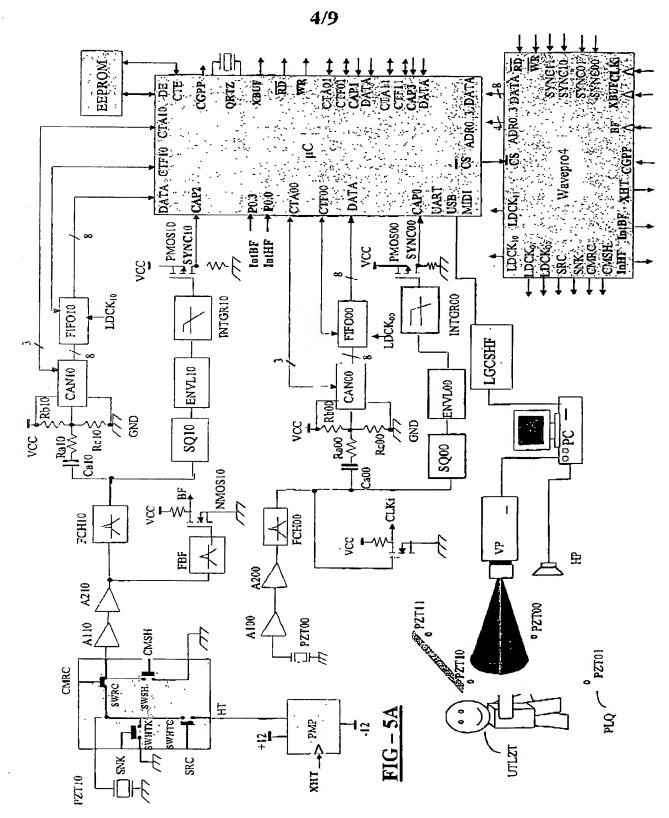

PCT/FR01/02088

5/9

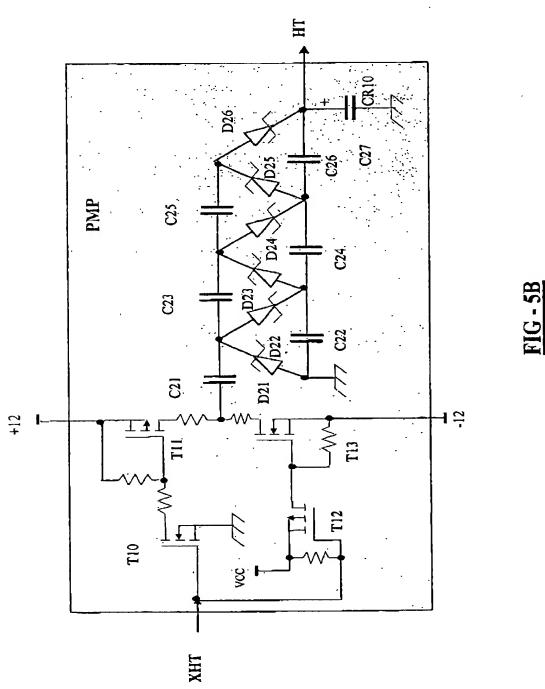

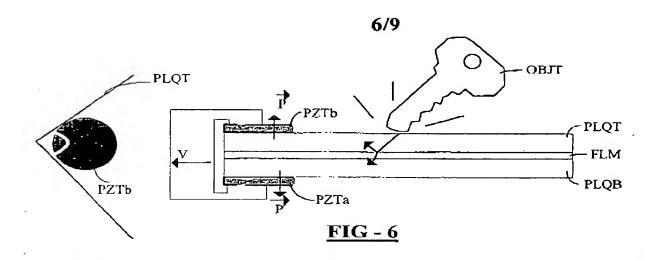




FIG - 7A






FIG - 7B

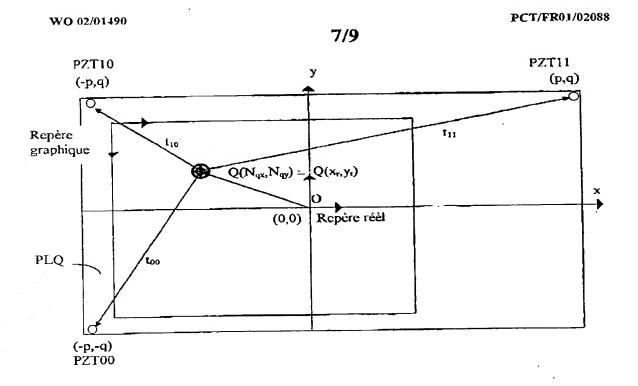

**FIG - 7C** 



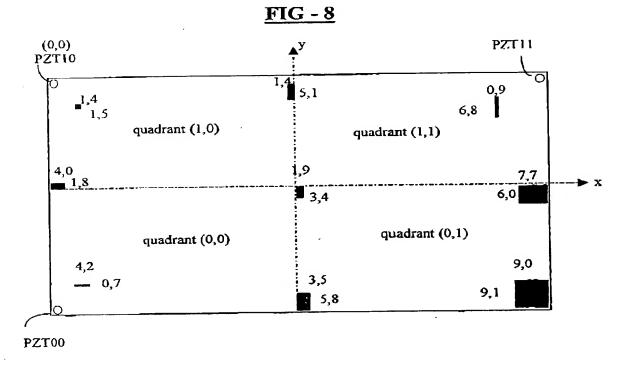


FIG - 9

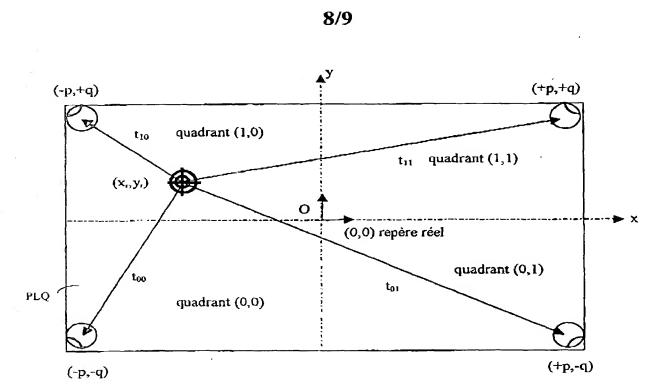


FIG - 10

